




Wiring Diagram

IL393 Section E

Rev. 3 - 6/94

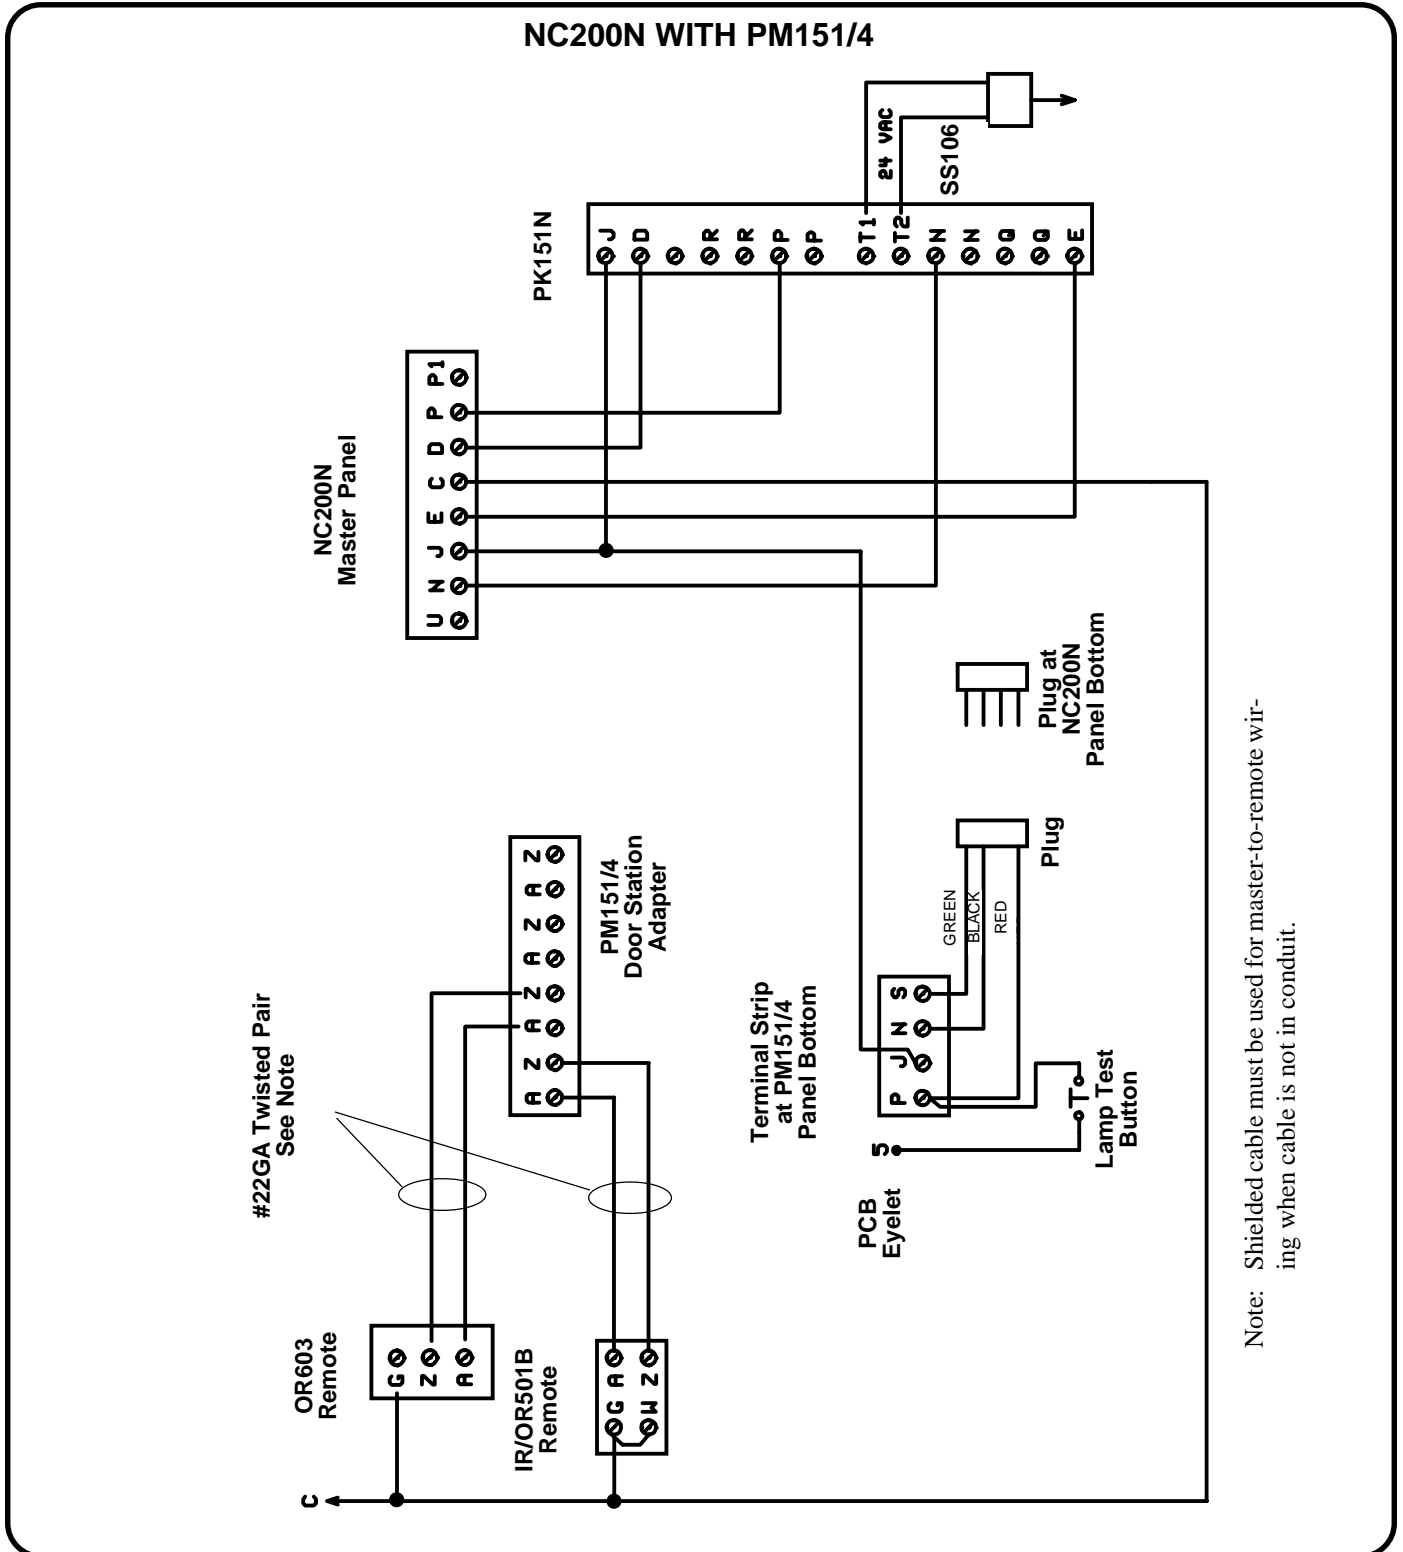

Note: Shielded cable must be used for master-to-remote wiring when cable is not in conduit.