


IR300B/IR301B/IR302B/IR310B/IR311B/IR312B/IR315B DUTY STATION
 HOOK-UP FOR LI380 DOME LIGHT AND/OR SINGLE CONTACT SMOKE
 DETECTOR.



- NOTES:
1. INPUTS CODE A & CODE B ARE NOT AVAILABLE FOR IR315B STATIONS.
 2. FIRE INDICATION AT THE NURSE MASTER STATION IS SUPPLEMENTARY ONLY. THE NC300 SYSTEM IS NOT INTENDED FOR USE AS A FIRE ALARM EVACUATION SYSTEM. INPUTS EMERG. AND MONITOR ARE NOT AVAILABLE WHEN A SINGLE CONTACT SMOKE DETECTOR IS IN USE.

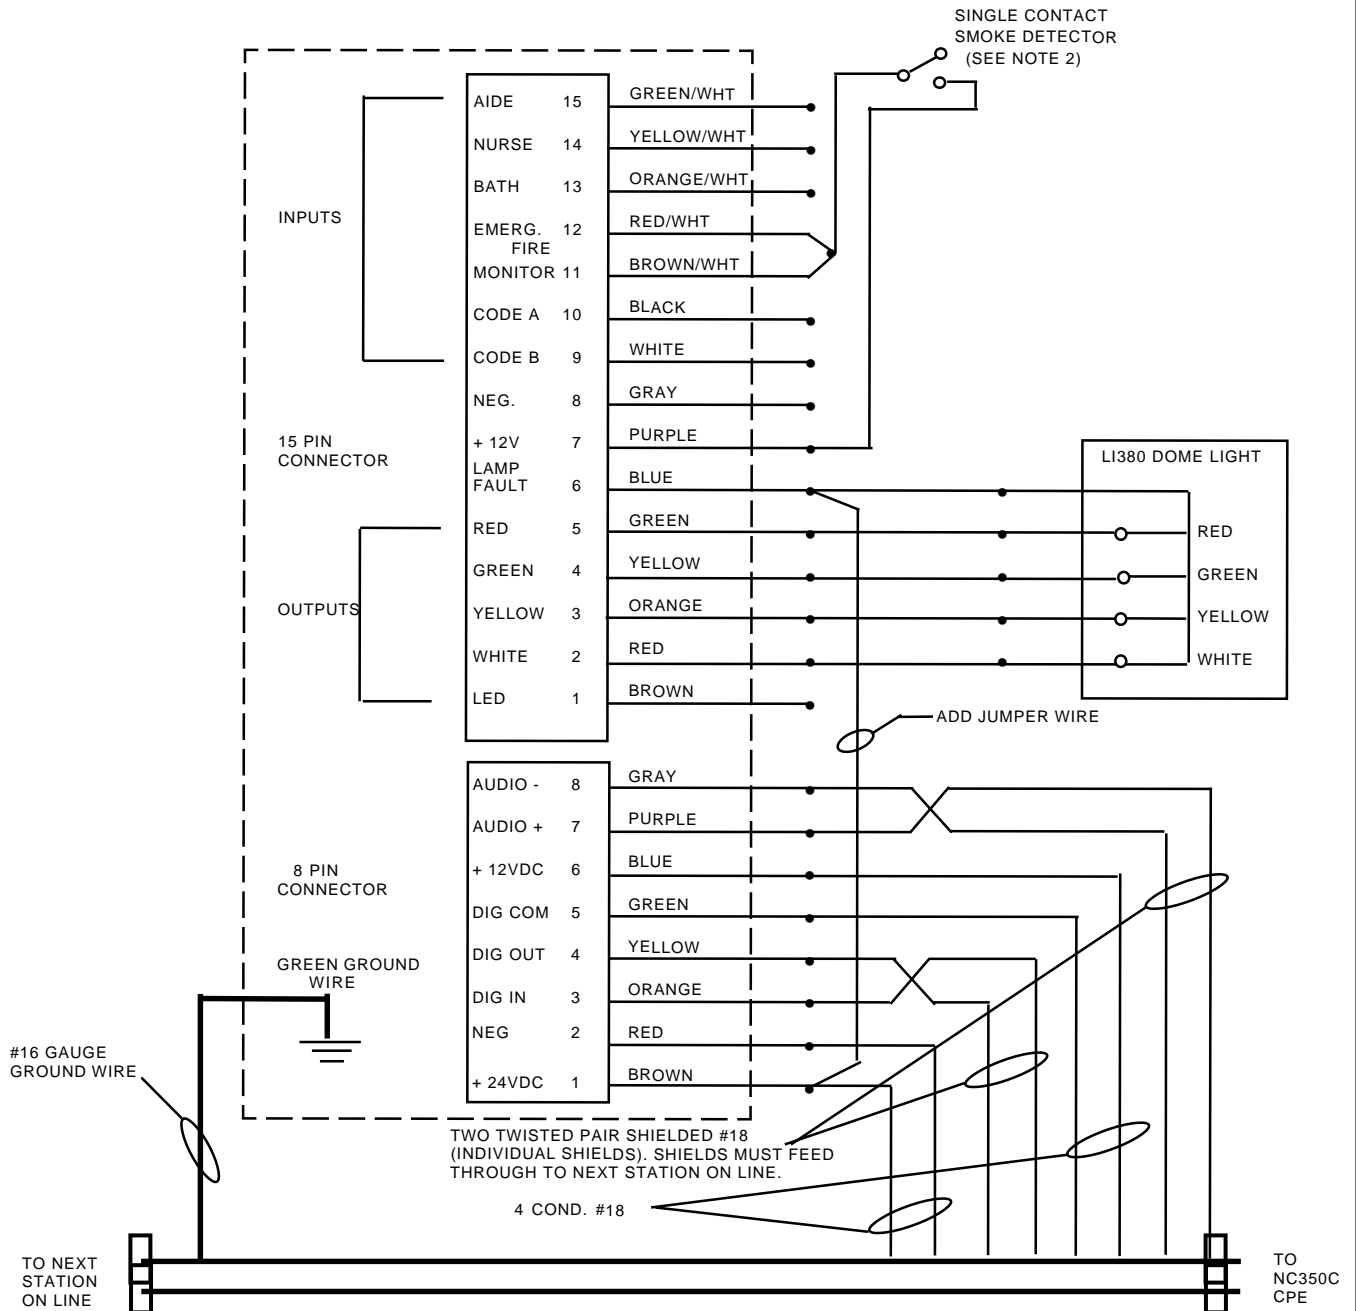

TekTone®

TITLE: LI380 DOME/ZONE LIGHT WIRING
 SINGLE CONTACT SMOKE DETECTOR WIRING
 APP: NC300 NURSE CALL SYSTEM

MATL: MEL
 REV: 8

DATE: 12/23/98
 PAGE: NL405